



**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

N° **0058/DEU/CPD/06**


Pag. **10**  
di/of  
pag. **24**

Data: **27/06/2006**  
Date:

Tested element: **SGG Stadip Protect 55.2**

Sample surface area            S =        1,9 m<sup>2</sup>  
Volume of receiving room       V =        86 m<sup>3</sup>  
Volume of source room         98 m<sup>3</sup>

FREQ. Hz	R dB
100	28,5
125	31,3
160	30,9
200	27,2
250	29,7
315	30,2
400	31,2
500	34,3
630	35,5
800	36,4
1000	35,2
1250	33,8
1600	32,9
2000	37,0
2500	40,9
3150	44,0
4000	47,8
5000	49,3

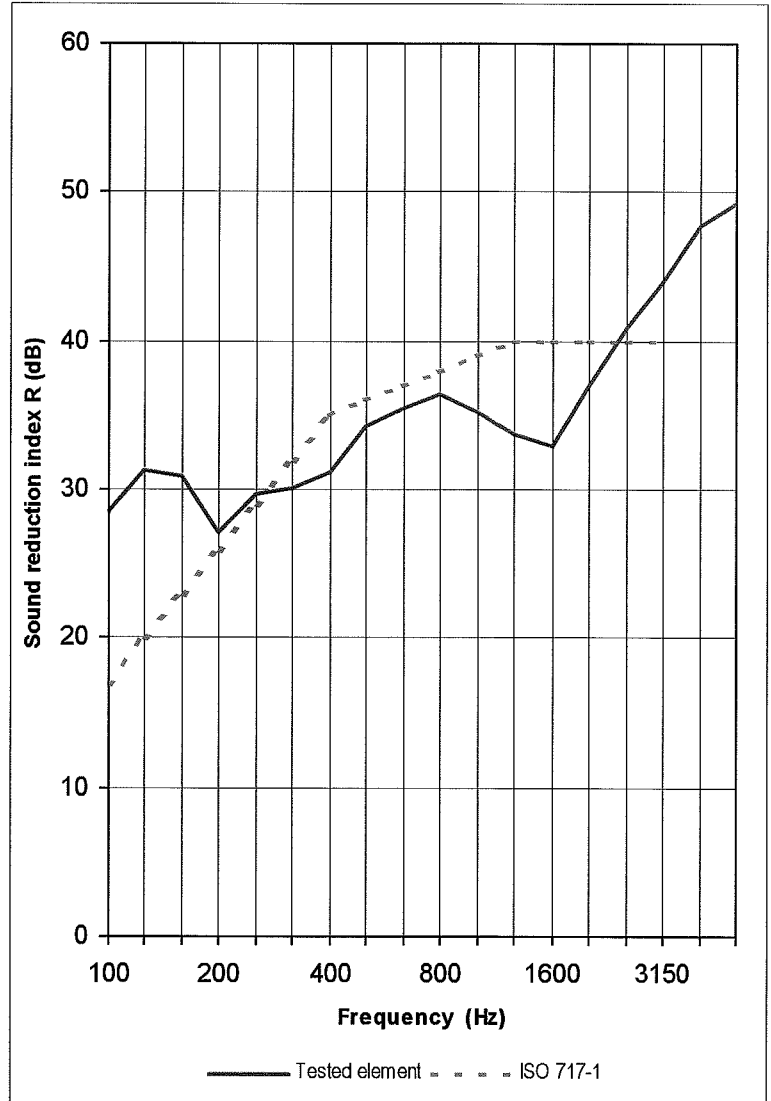

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**$R_w (C; C_{tr}) = 36 (-1 ; -2) \text{ dB}$**