

**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

Pag. **8**  
di/of  
pag. **24**


N° **0058/DEU/CPD/06**

Data: **27/06/2006**  
Date:

Tested element: **SGG Stadip Protect 44.2**

Sample surface area            S =        1,9 m<sup>2</sup>  
Volume of receiving room        V =        86 m<sup>3</sup>  
Volume of source room                98 m<sup>3</sup>

FREQ. Hz	R dB
100	22,0
125	26,4
160	26,6
200	26,5
250	26,8
315	28,1
400	28,6
500	32,4
630	33,7
800	35,3
1000	35,8
1250	34,5
1600	32,1
2000	32,3
2500	36,7
3150	40,3
4000	44,5
5000	46,3

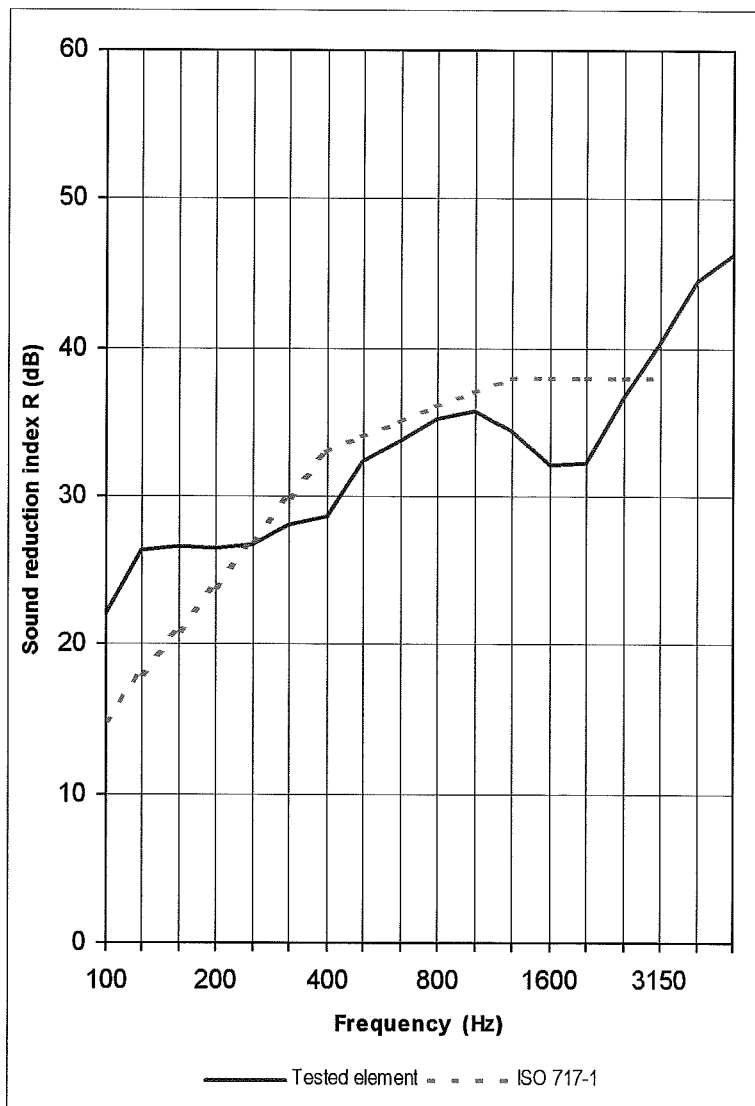

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**R<sub>w</sub> (C; C<sub>tr</sub>) = 34 (-1 ; -2) dB**