



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

N° **0058/DEU/CPD/06**


Pag. **21**
di/of
pag. **24**

Data: **27/06/2006**
Date:

Tested element: **SGG Stadip Silence 64.1**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room 98 m³

FREQ. Hz	R dB
100	29,0
125	28,9
160	31,3
200	28,7
250	30,3
315	30,9
400	32,2
500	35,0
630	36,3
800	37,6
1000	38,6
1250	39,4
1600	39,6
2000	38,9
2500	40,9
3150	44,3
4000	49,2
5000	51,2

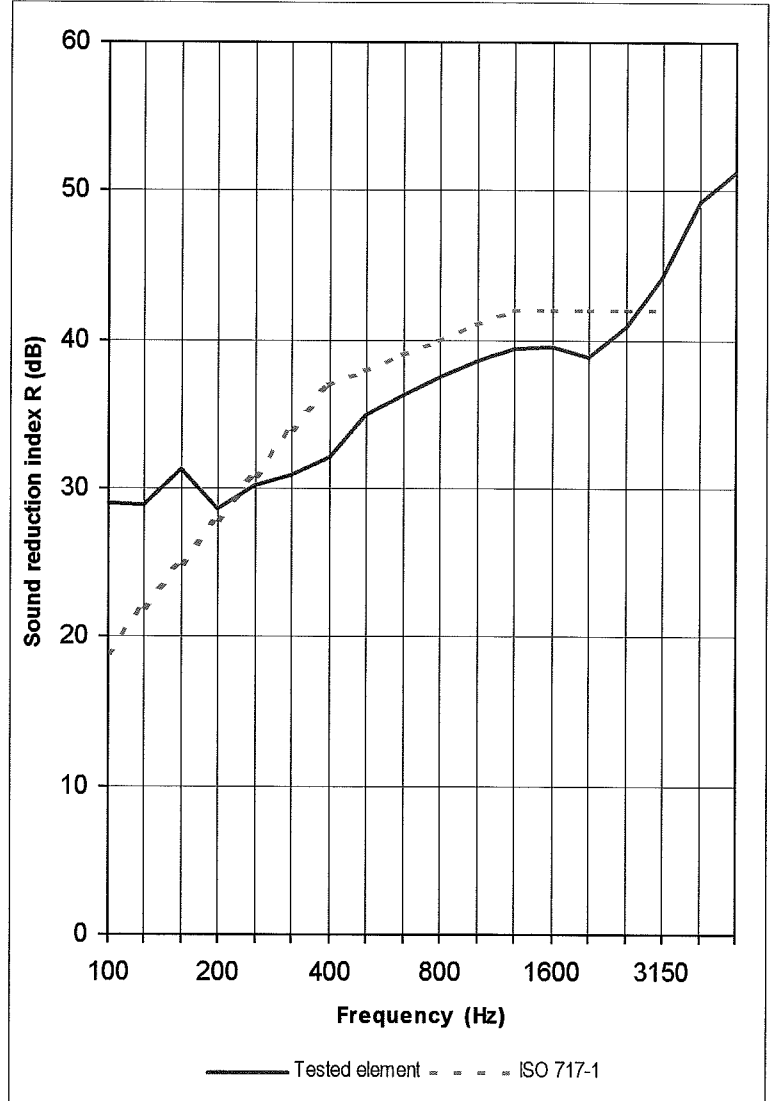

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

R_w (C; C_{tr}) = 38 (-1 ; -3) dB