



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

Pag. 17
di/of
pag. 24


N° 0058/DEU/CPD/06

Data: 27/06/2006
Date:

Tested element: **SGG Stadip Silence 44.1**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room 98 m³

FREQ. Hz	R dB
100	25,9
125	26,7
160	30,1
200	26,8
250	29,2
315	30,3
400	31,1
500	33,7
630	34,7
800	36,4
1000	37,5
1250	38,9
1600	40,1
2000	40,0
2500	38,5
3150	39,5
4000	44,6
5000	46,8

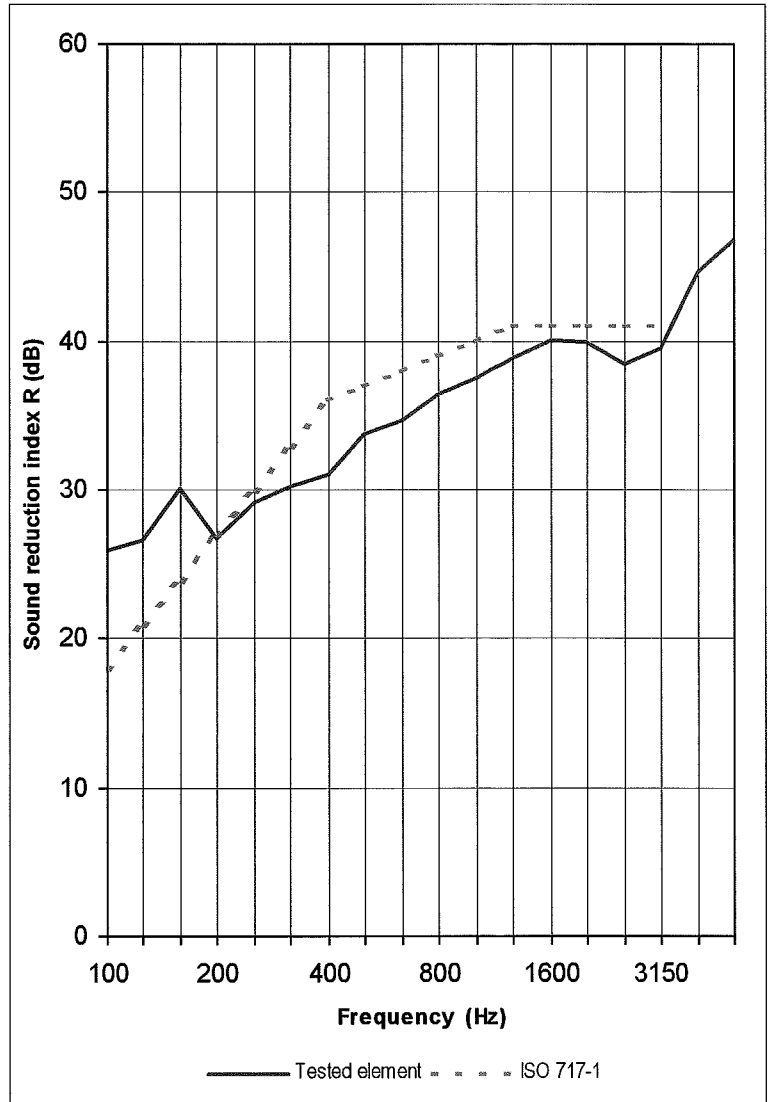

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

R_w (C;C_{tr}) = 37 (-1 ; -3) dB