



**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

N° **0058/DEU/CPD/06**


Pag. **20**  
di/of  
pag. **24**

Data: **27/06/2006**  
Date:

Tested element: **SGG Stadip Silence 55.2**

Sample surface area      S =      1,9 m<sup>2</sup>  
Volume of receiving room      V =      86 m<sup>3</sup>  
Volume of source room      98 m<sup>3</sup>

FREQ. Hz	R dB
100	24,7
125	29,0
160	32,5
200	29,2
250	31,3
315	31,8
400	32,8
500	35,5
630	37,0
800	38,1
1000	39,2
1250	39,8
1600	39,8
2000	39,4
2500	40,9
3150	44,2
4000	48,9
5000	51,1

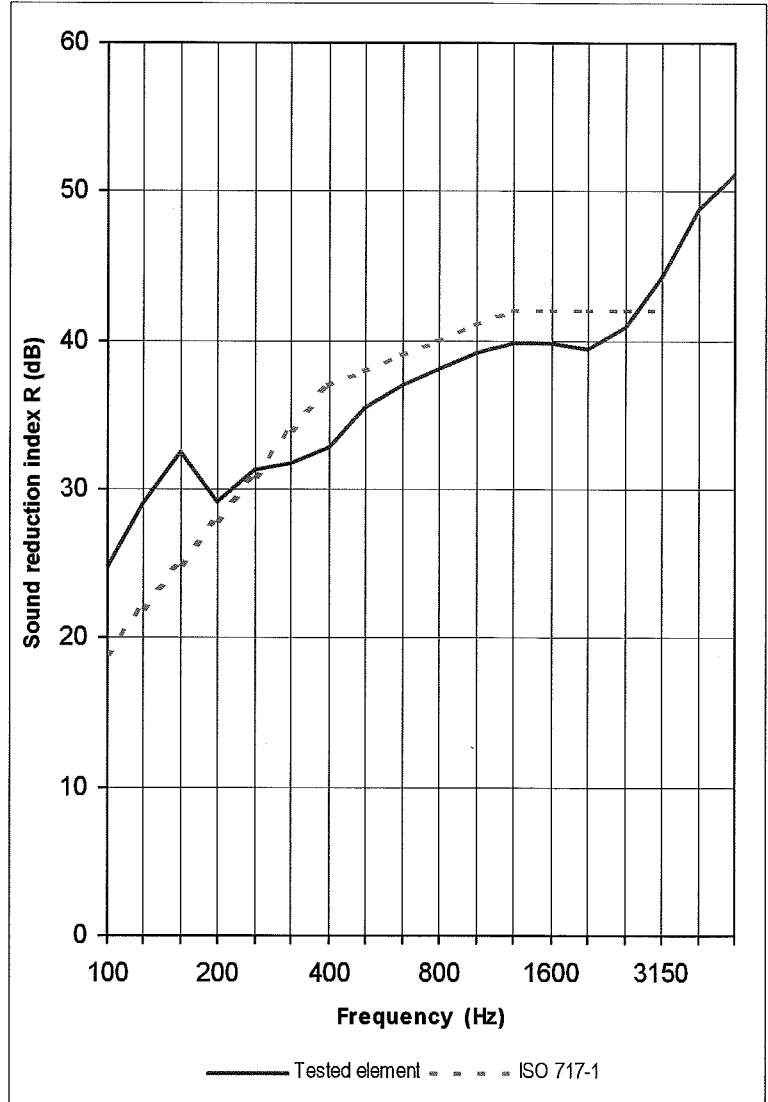

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**R<sub>w</sub> (C; C<sub>tr</sub>) = 38 ( 0 ; -2 ) dB**