



**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

Pag. **16**  
di/of  
pag. **24**


N° **0058/DEU/CPD/06**

Data: **27/06/2006**  
Date:

Tested element: **SGG Stadip Silence 33.2**

Sample surface area            S =            1,9 m<sup>2</sup>  
Volume of receiving room        V =            86 m<sup>3</sup>  
Volume of source room                                    98 m<sup>3</sup>

FREQ. Hz	R dB
100	22,0
125	24,4
160	28,8
200	26,0
250	28,1
315	28,5
400	29,2
500	31,9
630	33,5
800	34,4
1000	35,9
1250	37,3
1600	38,1
2000	38,8
2500	38,8
3150	38,2
4000	39,3
5000	41,6

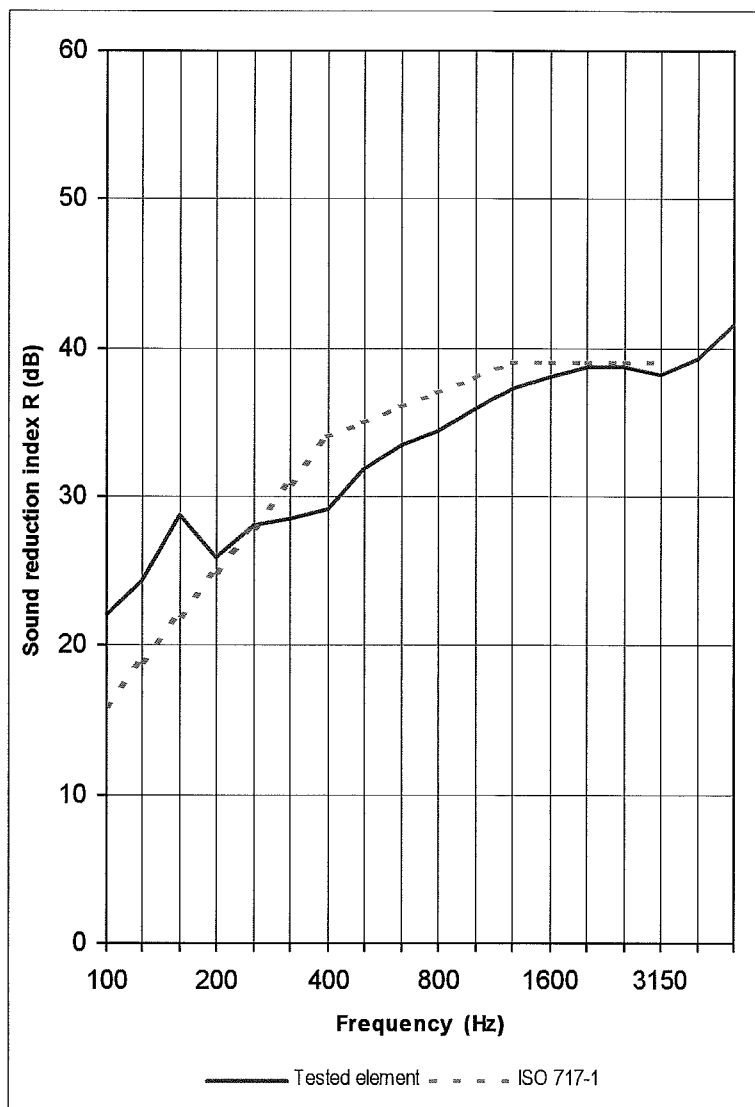

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**$R_w (C; C_{tr}) = 35 (0 ; -3) \text{ dB}$**