




**CSI**  
Certificazione e Testing

## TEST RESULTS

Tested element: **SGG Stadip Silence 33.1**

Sample surface area      S =      1,9 m<sup>2</sup>  
Volume of receiving room      V =      86 m<sup>3</sup>  
Volume of source room           98 m<sup>3</sup>

FREQ. Hz	R dB
100	22,5
125	25,1
160	28,8
200	25,7
250	27,9
315	28,5
400	29,1
500	31,6
630	33,2
800	34,4
1000	35,7
1250	37,2
1600	38,1
2000	38,8
2500	38,7
3150	38,0
4000	39,6
5000	42,0

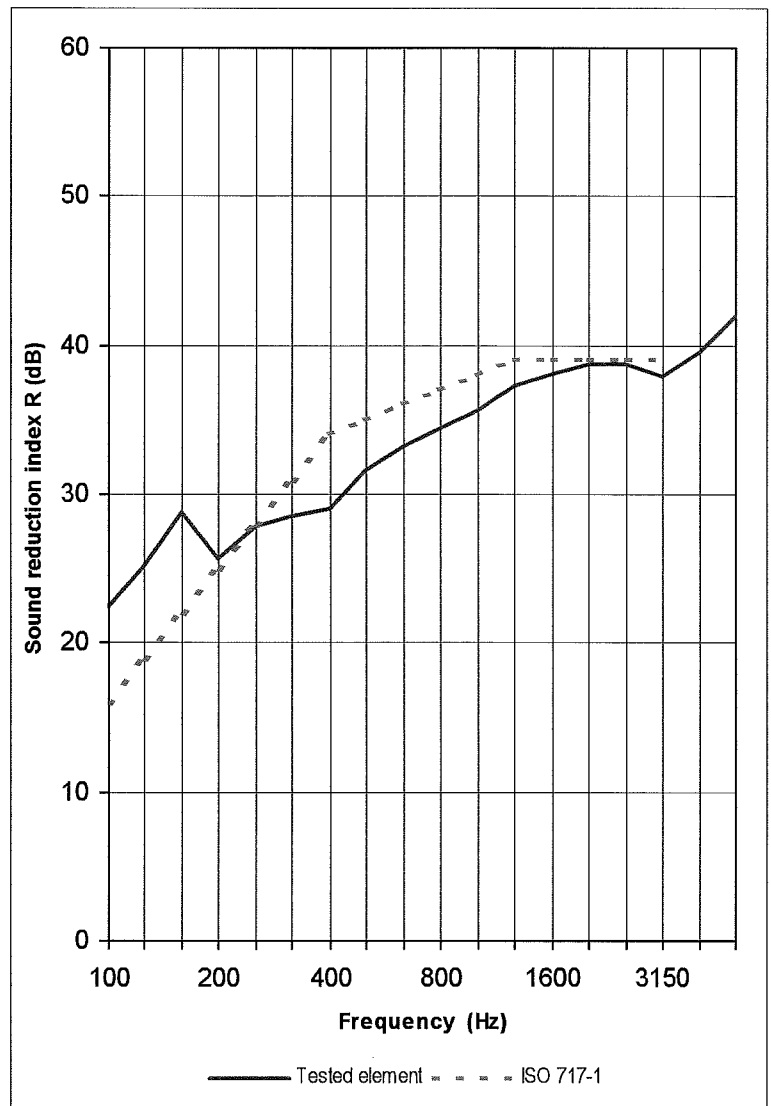

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**$R_W (C; C_{tr}) = 35 (0; -3) \text{ dB}$**