



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

N° **0058/DEU/CPD/06**


Pag. **6**
di/of
pag. **24**

Data: **27/06/2006**
Date:

Tested element: **SGG Stadip Protect 33.2**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room 98 m³

FREQ. Hz	R dB
100	19,4
125	21,4
160	27,7
200	24,0
250	27,9
315	27,9
400	28,7
500	31,7
630	33,0
800	33,9
1000	35,0
1250	35,5
1600	34,6
2000	31,1
2500	31,1
3150	35,2
4000	40,4
5000	42,4

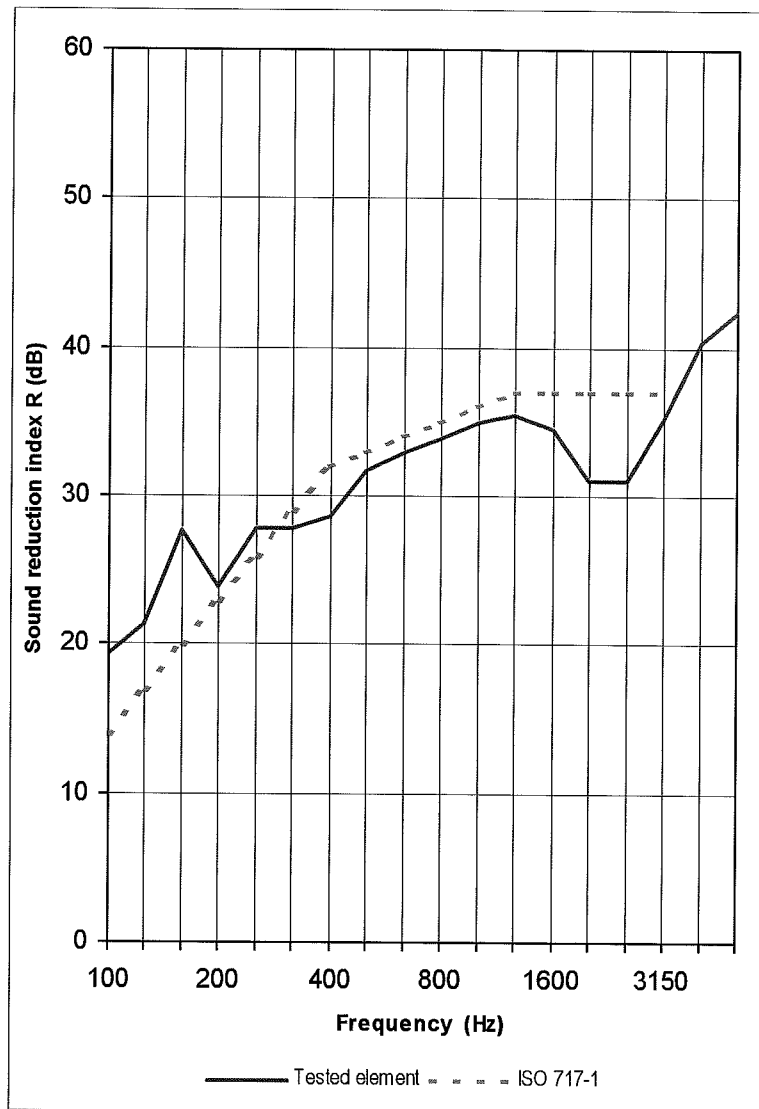

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

$R_w(C;C_{tr}) = 33 (-1 ; -2) \text{ dB}$