




**CSI**  
Certificazione e Testing

## TEST RESULTS

Tested element: **SGG Stadip 33.1**

Sample surface area            S =            1,9 m<sup>2</sup>  
Volume of receiving room       V =            86 m<sup>3</sup>  
Volume of source room         98 m<sup>3</sup>

FREQ. Hz	R dB
100	20,6
125	21,0
160	25,8
200	24,8
250	27,8
315	28,2
400	28,4
500	31,1
630	32,9
800	33,9
1000	35,0
1250	35,5
1600	34,6
2000	30,4
2500	30,4
3150	34,7
4000	40,0
5000	42,1

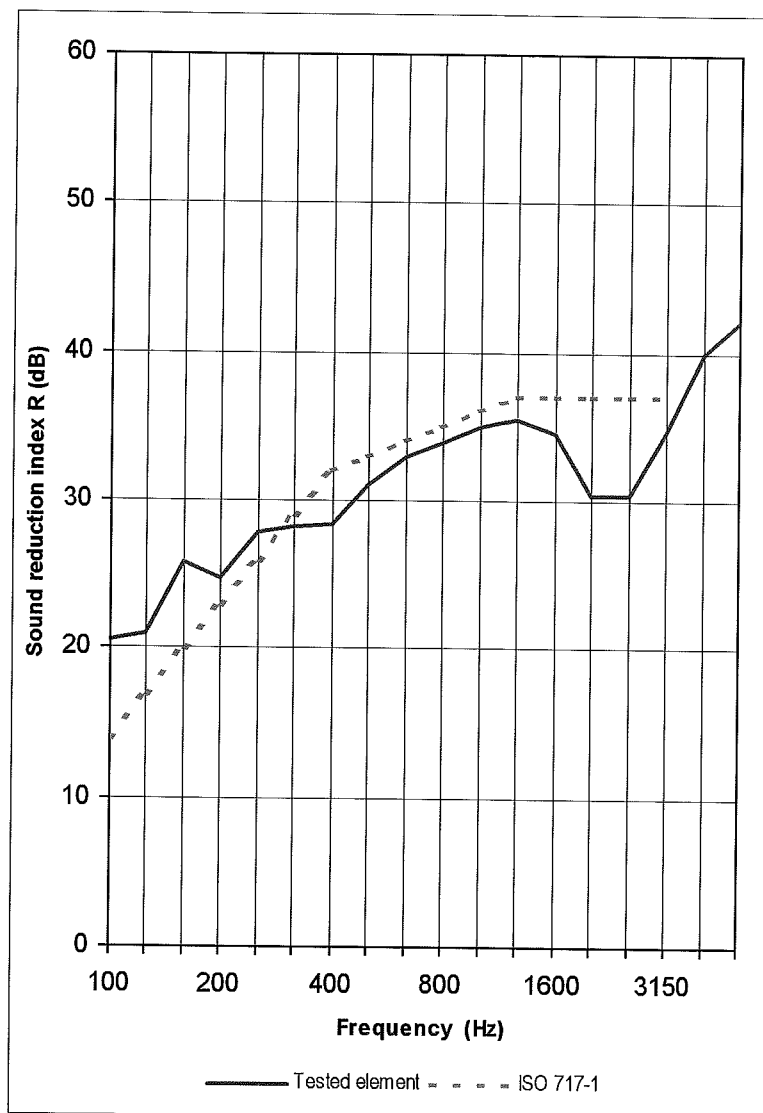

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**$R_w (C; C_{tr}) = 33 (-1 ; -2) \text{ dB}$**