



**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

N° **0225/DEU/CPD/06**


Pag. **21**  
di/of  
pag. **31**

Data: **27/10/2006**  
Date:

Tested element: **SGG PLANILUX 8 (16) SGG STADIP PROTECT 44-2**

Sample surface area            S =            1,9 m<sup>2</sup>  
Volume of receiving room        V =            86 m<sup>3</sup>  
Volume of source room                                    98 m<sup>3</sup>

FREQ. Hz	R dB
100	22,8
125	28,6
160	19,7
200	22,1
250	25,9
315	27,6
400	31,4
500	35,2
630	38,2
800	41,6
1000	42,8
1250	40,6
1600	38,6
2000	40,6
2500	45,4
3150	49,0
4000	53,6
5000	55,6

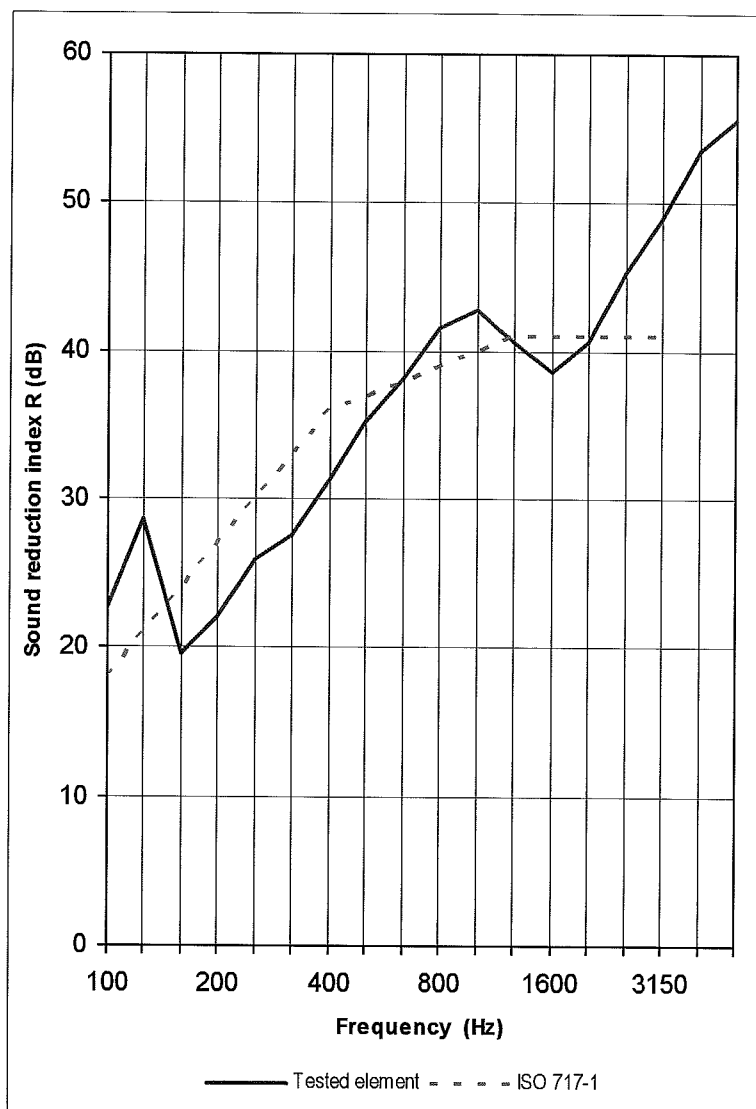

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**R<sub>w</sub> (C; C<sub>tr</sub>) = 37 (-2 ; -5) dB**