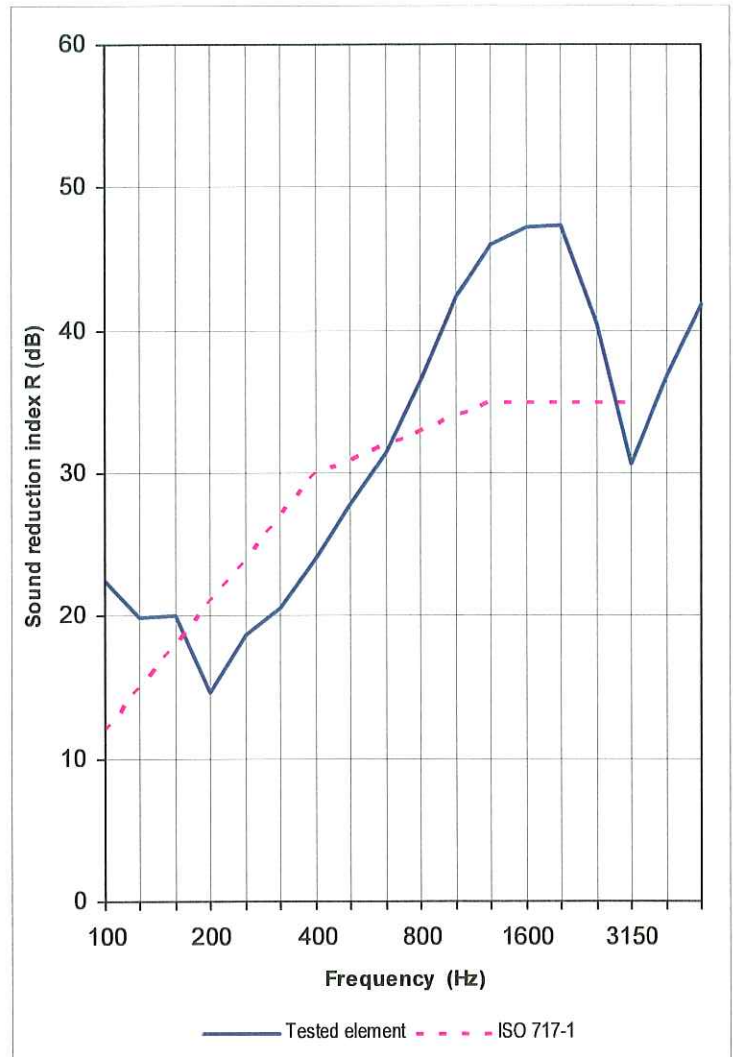


Tested element: **SGG Planilux 4 (12) SGG Planilux 4 (12) SGG Planilux 4**


 Specimen surface
 Receiving room volume
 Source room volume

 S = 1,88m²
 V = 86m³
 98m³

FREQ. Hz	R dB
100	22,4
125	19,9
160	20,0
200	14,7
250	18,7
315	20,6
400	24,1
500	27,8
630	31,5
800	36,4
1000	42,4
1250	46,0
1600	47,2
2000	47,3
2500	40,5
3150	30,7
4000	36,9
5000	41,8

 $R_w (C; C_{tr}) = 31 (-1 ; -5) \text{ dB}$


Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

IL RESP. Divisione Costruzioni
Division Head
Ing. Mele

IL RESP. DEL CENTRO
Managing Director
P. Cau
