


Tested element: SGG CLIMAPLUS 22-1SI (14 Ar) 10

Specimen surface  
Receiving room volume  
Source room volume

S = 1,88m<sup>2</sup>  
V = 86m<sup>3</sup>  
98m<sup>3</sup>

| FREQ.<br>Hz | R<br>dB |
|-------------|---------|
| 100         | 30,0    |
| 125         | 25,2    |
| 160         | 24,4    |
| 200         | 23,2    |
| 250         | 26,7    |
| 315         | 28,9    |
| 400         | 34,3    |
| 500         | 37,2    |
| 630         | 40,3    |
| 800         | 44,0    |
| 1000        | 44,8    |
| 1250        | 46,8    |
| 1600        | 48,9    |
| 2000        | 51,4    |
| 2500        | 53,3    |
| 3150        | 54,7    |
| 4000        | 57,1    |
| 5000        | 58,8    |

**R<sub>w</sub> (C;C<sub>tr</sub>) = 40 (-2 ; -6) dB**

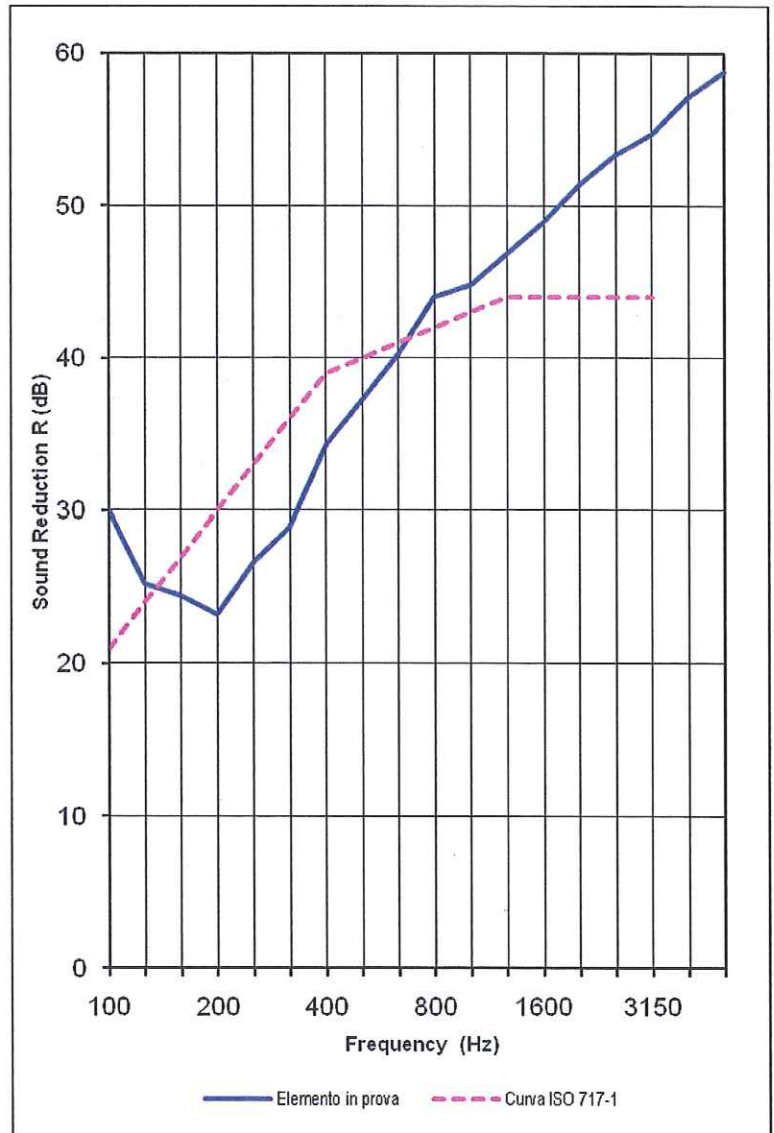

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements: