



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

Pag. 6
di/of
pag. 18

N° 0007/DC/ACU/10 rev.1

Data: 03/02/2010
Date:


Tested element: SGG CLIMATOP 22-1SI (12 Ar) 4 (12 Ar) 4

Specimen surface
Receiving room volume
Source room volume

S = 1,88m²
V = 86m³
98m³

FREQ. Hz	R dB
100	25,2
125	21,7
160	21,9
200	19,4
250	22,6
315	24,6
400	27,5
500	30,4
630	34,3
800	39,5
1000	46,6
1250	53,5
1600	56,2
2000	57,5
2500	53,8
3150	47,5
4000	52,7
5000	55,6

R_W (C;C_{tr}) = 35 (-1 ; -5) dB

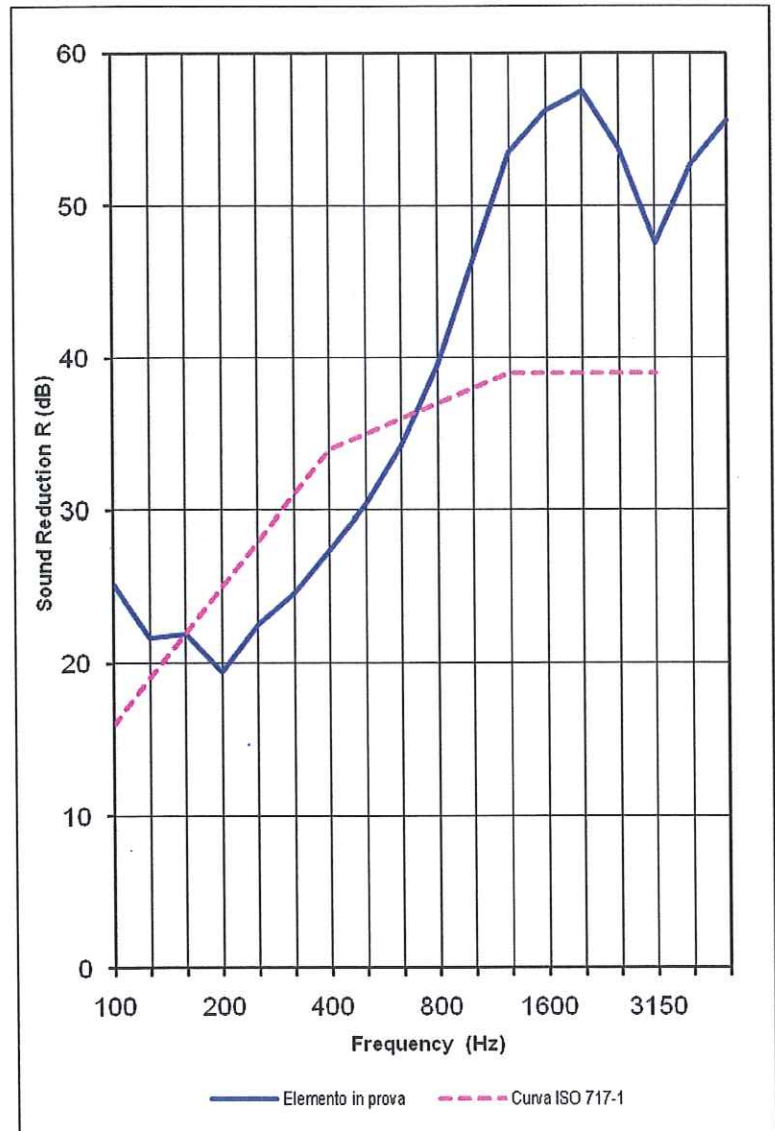

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements: