



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

Pag. 7
di/of
pag. 18

N° 0007/DC/ACU/10 rev.1


Data: 03/02/2010
Date:

Tested element: SGG CLIMATOP 22-1SI (12 Ar) 4 (12 Ar) 6

Specimen surface
Receiving room volume
Source room volume

S = 1,88m²
V = 86m³
98m³

FREQ. Hz	R dB
100	24,2
125	18,1
160	20,9
200	22,9
250	26,7
315	29,8
400	32,4
500	35,5
630	38,3
800	43,3
1000	49,1
1250	52,7
1600	52,7
2000	50,0
2500	50,9
3150	53,3
4000	57,4
5000	59,8

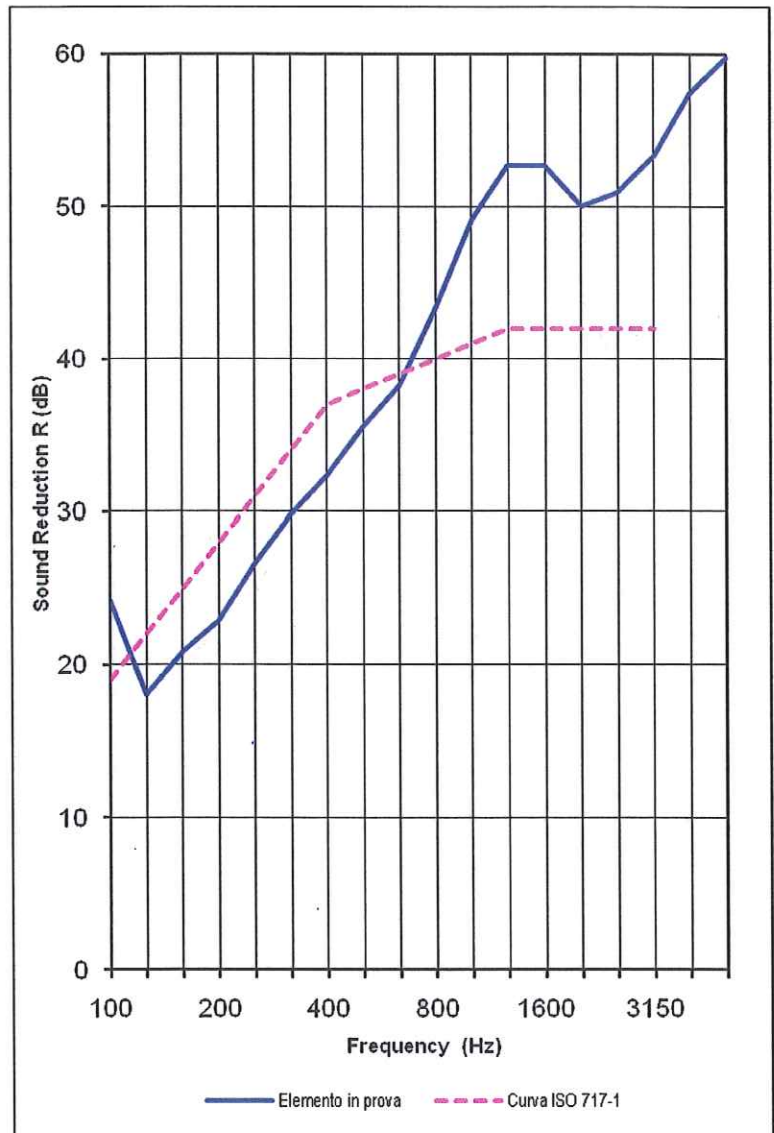

R_w (C;C_{tr}) = 38 (-1 ; -6) dB

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements: