



**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

N° 0007/DC/ACU/10 rev.1

Pag. 12

di/of

pag. 18

Date: 03/02/2010

Date:


Tested element: SGG CLIMATOP 4 (12 Ar) 3 (12 Ar) 3

Specimen surface  
Receiving room volume  
Source room volume

$S = 1,88\text{m}^2$   
 $V = 86\text{m}^3$   
 $98\text{m}^3$

FREQ. Hz	R dB
100	24,9
125	22,8
160	19,2
200	16,8
250	19,2
315	20,5
400	23,9
500	26,8
630	31,3
800	34,8
1000	41,7
1250	48,8
1600	53,6
2000	54,4
2500	52,2
3150	46,8
4000	43,8
5000	46,9

$R_w (C; C_{tr}) = 31 (0 ; -4) \text{ dB}$

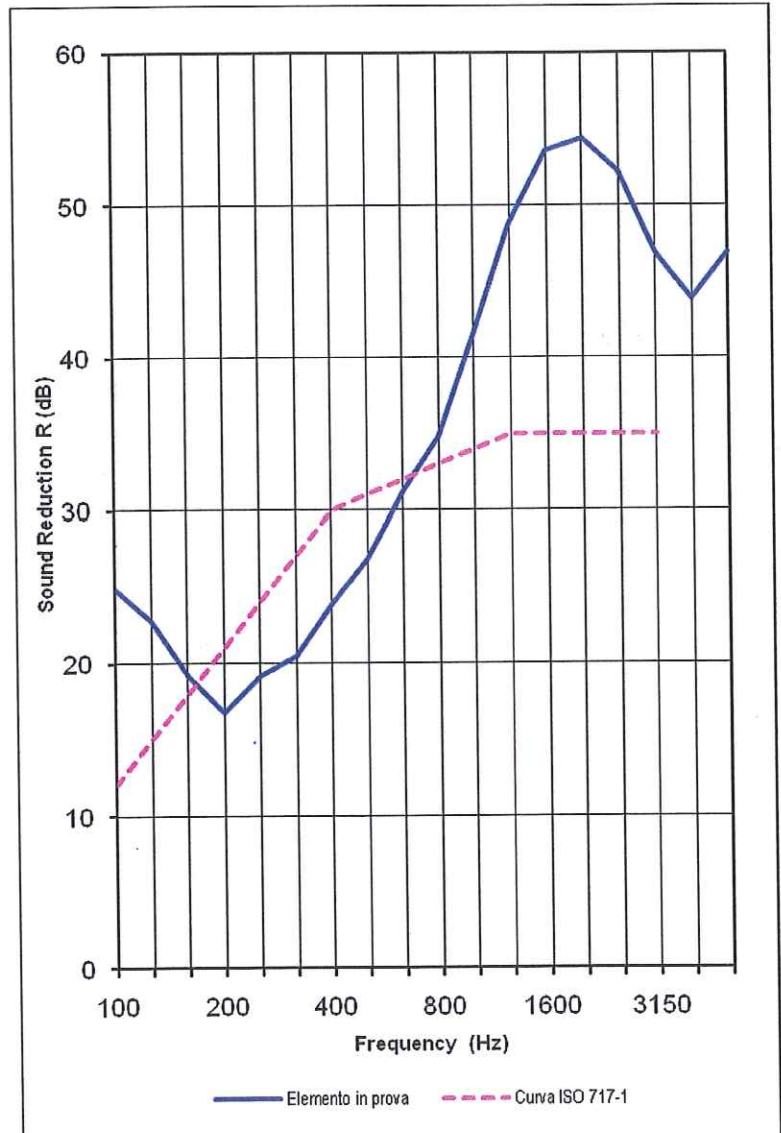

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements: